

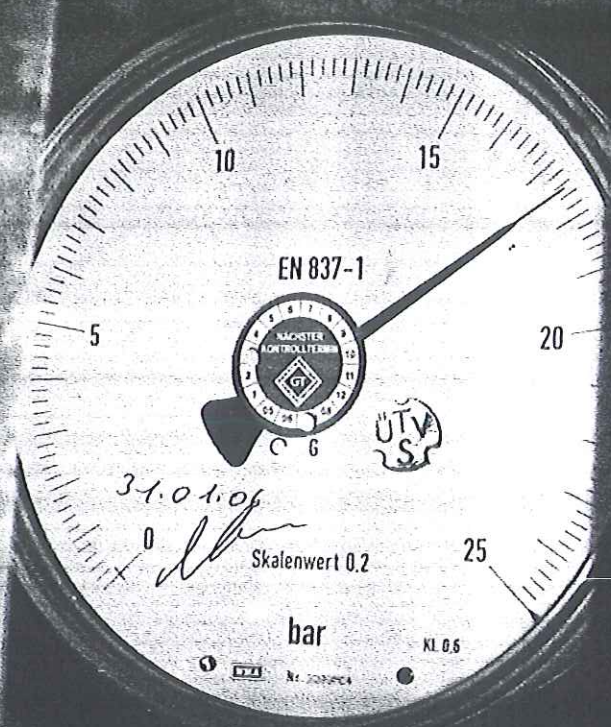


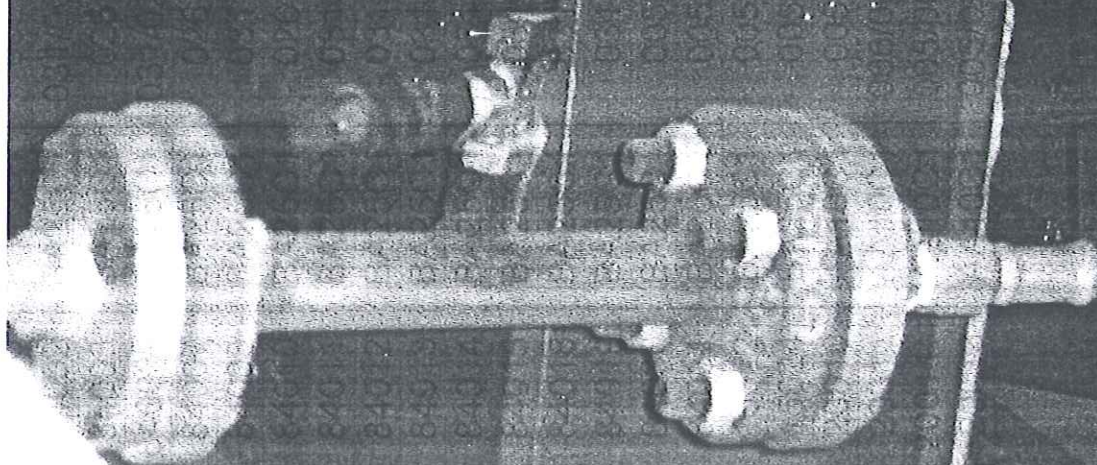

PK. 11

LN. 250 D 20006

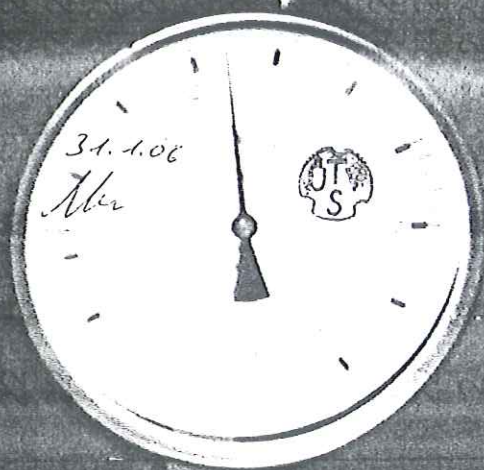

rn.	DN	Fl.	Pi.nr.	Pipe class	P&I	Mat.	bar	Test Med.	Test	hold time	Bereich	Datum
1	200	WC	80007	AA10C2	002	1.0254	8	N	8,8	30 min	CW Pumpe 13001	05.01.06
1	200	WC	80009	AA10C2	002	1.0254	8	N	8,8	30 min	CW Pumpe 13001	05.01.06
2	80	WC	12003	AA10C2	002/003	1.0254	16	N	17,6	30 min	CW Pumpe 14001	07.01.06
2	100	WC	14002	AA16C1	003/002	1.0254	16	N	17,6	30 min	CW Pumpe 14001	07.01.06
2	100	WC	14004	AA16C1	003	1.0254	16	N	17,6	30 min	CW Pumpe 14001	07.01.06
2	100	WC	14005	AA16C1	002	1.0254	16	N	17,6	30 min	CW Pumpe 14001	07.01.06
2	100	WC	14006	AA16C1	002	1.0254	16	N	17,6	30 min	CW Pumpe 14001	07.01.06
3	100	S	84002	BA25C1	031/005	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	250	S	84003	BA25C1	026	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	100	S	84003 1	BA25C1	031/026	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84007	BA25C1	026	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84008	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84010	BA25C1	026	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84011	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84012	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84013	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84014	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84015	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84018	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84019	BA25C1	031	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84030	BA25C1	005	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	S	84031	BA25C1	005	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	C	15022	BA25C1	005	1.0305	22	N	24,2	30 min	Dampf	10.01.06
3	25	C	15024	BA25C1	005	1.0305	22	N	24,2	30 min	Dampf	10.01.06
5	500	N	20010	AA10C1	005	1.0254	2	N	2,2	30 min	N2	11.01.06
5	700	N	20011	AA10C1	006/005	1.0254	2	N	2,2	30 min	N2	11.01.06
5	600	N	20011 1	AA10C1	005/003	1.0254	2	N	2,2	30 min	N2	11.01.06
5	100	N	20013	AA10C1	005/024	1.0254	2	N	2,2	30 min	N2	11.01.06

rn.	DN	Fl.	Pi.nr.	Pipe class	P&I	Mat.	bar	Test Med.	Test	hold time	Bereich	Datum
4	300	WC	11003	AA10C2	023/001	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	200	WC	13020 1	AA10C2	002/023	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	13020 2	AA10C2	002	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	80	WC	13026	AA10C2	002	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	300	WC	16003	AA10C2	006/023	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	50	WC	24101	AA10C2	029/023	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	50	WC	24201	AA10C2	030/023	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	1000	WC	24301	AA10C1	008	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	70020	AA10C2	019/023	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	70021	AA10C2	019/023	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	100	WC	70022	AA10C2	019	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	100	WC	70023	AA10C2	020	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	1000	WC	80001	AA10C2	023/001	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	300	WC	80002	AA10C2	023/029	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	300	WC	80003	AA10C2	002	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	50	WC	80005	AA10C2	023/029	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	200	WC	80006	AA10C2	002	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	80	WC	80006 1	AA10C2	023/030	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	80007 1	AA10C2	023/019	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	200	WC	80008	AA10C2	002	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	80008 1	AA10C2	002	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	80010	AA10C2	002	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	100	WC	80011	AA10C2	002/003	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	80014	AA10C2	001	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	150	WC	80015	AA10C2	006	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	80	WC	80016	AA10C2	029	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06
4	80	WC	80017	AA10C2	030	1.0254	8	N	8,8	30 min	CW "Untergrund"	09.01.06

pressure test

ASU Nr.9 Kosice

nr.	DN	Fl.	Pi.nr.	Pipe class	P&I	Mat.	bar	Test Med.	Test	hold time	Bereich	Datum
6	600	A	11001	AA10C1	001/002	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	700	A	11001-1	AA10C1	001/002	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	400	A	11002	AA10C1	001	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	700	A	13001	AA10C1	002/004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	700	A	13002	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	100	A	13003	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	100	A	13004	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	700	A	15001	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	700	A	15002	AA10C1	004/005	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	500	A	15002 1	AA10C1	006/009	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	700	A	15003	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	100	A	15004	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	500	A	15005	AA10C1	006	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	600	N	15006	AA10C1	005/004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	600	N	15008	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	150	A	15009	AA10C1	006	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	100	N	15011	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	100	N	15013	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	400	A	15015	AA10C1	004/005	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	200	A	15015 1	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	50	A	15016	AA10C1	004/025	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	80	A	15018	AA10C1	004	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	40	A	15030	AA10C1	004/007	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	40	A	15031	AA10C1	004/008	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15033	AA10C1	004/012	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15034	AA16C1	004/015	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15035	AA16C1	015	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15036	AA10C1	004/016	1.0254	6	N	6,6	30 min	Luft	20.01.06

pressure test

ASU Nr.9 Kosice

rn.	DN	Fl.	Pi.nr.	Pipe class	P&I	Mat.	bar	Test Med.	Test	hold time	Bereich	Datum
6	25	A	15037	AA10C1	012	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15038	AA10C1	004/018	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	50	A	15040	AA10C1	025	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15041	AA10C1	025	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15042	AA10C1	025	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15043	AA10C1	025	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15044	AA10C1	025	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	15045	AA10C1	025	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	16004	AA63C1	007/029	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	25	A	16005	AA63C1	007/030	1.0254	6	N	6,6	30 min	Luft	20.01.06
6	500	N	20010	AA10C1	005	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	500	N	20012	AA10C1	005	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	500	N	20016	AA10C1	005	1.0254	6	N	6,6	30 min	Luft	18.01.06
6	50	N	81003	AA10C1	025	1.0254	6	N	6,6	30 min	Luft	18.01.06
7	100	N	20004	ZB40C1	009/010	1.4541	30	N	33	30 min	HP Gan	11.01.06
7	150	N	20018	ZB40C1	010	1.4541	30	N	33	30 min	HP Gan	11.01.06
7	80	N	20018 1	ZB40C1	010	1.4541	30	N	33	30 min	HP Gan	11.01.06
8	600	N	20008	AA10C1	009/010	1.0254	2	N	2,2	30 min	Stickstoff	18.01.06
8	400	N	20008 1	AA10C1	010/019	1.0254	2	N	2,2	30 min	Stickstoff	18.01.06
8	500	N	20009	AA10C1	010/020	1.0254	2	N	2,2	30 min	Stickstoff	18.01.06
8	400	N	20017	AA10C1	010	1.0254	2	N	2,2	30 min	Stickstoff	18.01.06
9	200	N	70074	AA16C1	019	1.0254	16	N	17,6	30 min	Stickstoff DN 350	31.01.06
9	200	N	77074	AA16C1	020	1.0254	16	N	17,6	30 min	Stickstoff DN 350	31.01.06
9	350	N	75005	AA10C1	019/020	1.0254	16	N	17,6	30 min	Stickstoff DN 350	31.01.06
9	250	N	75005 1	AA10C1	019/020	1.0254	16	N	17,6	30 min	Stickstoff DN 350	31.01.06
9	150	N	75006	AA16C1	019	1.0254	16	N	17,6	30 min	Stickstoff DN 350	31.01.06
9	250	N	76005	AA16C1	020	1.0254	16	N	17,6	30 min	Stickstoff DN 350	31.01.06
9	150	N	76006	AA16C1	020	1.0254	16	N	17,6	30 min	Stickstoff DN 350	31.01.06

PK 4 31.01.06


rn.	DN	Fl.	Pi.nr.	Pipe class	P&I	Mat.	bar	Test Med.	Test	hold time	Bereich	Datum
10	250	A	16001	AA63C1	006/009	1.0254	58	N	63,8	30 min	HP Air	01.02.06
10	150	A	16002	AA63C1	006	1.0254	58	N	63,8	30 min	HP Air	01.02.06
10	25	A	16004	AA63C1	007/029	1.0254	58	N	63,8	30 min	HP Air	01.02.06
10	25	A	16005	AA63C1	007/030	1.0254	58	N	63,8	30 min	HP Air	01.02.06
11	250	O	20006	ZB40C1	009/010	1.4541	40	N	44	30 min	LOX	31.01.06
11	150	O	20019 1	ZB40C1	010	1.4541	40	N	44	30 min	LOX	31.01.06
12	80	N	81002	AA10C1	025	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	50	N	81004	AA10C1	025/024	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	15	N	81006	AA10C1	025/012	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	15	N	81007	AA10C1	025/021	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	15	N	81008	AA10C1	025/022	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	15	N	81009	AA10C1	025/016	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	40	N	81010	AA10C1	025/028	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	15	N	81013	AA10C1	037	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	25	N	81025	AA10C1	025/029	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
12	25	N	81026	AA10C1	025/030	1.0254	6	N	6,6	30 min	Sealgas	20.01.06
13	50	R	48033	ZB40C1	044	1.4541	22	N	24,2	30 min	Argon HP	27.01.06
13	25	R	48033 1	ZB40C1	044	1.4541	22	N	24,2	30 min	Argon HP	27.01.06
13	25	R	48034	ZB40C1	044	1.4541	22	N	24,2	30 min	Argon HP	27.01.06
13	50	R	48034 1	ZB40C1	044	1.4541	22	N	24,2	30 min	Argon HP	27.01.06
14	80	RL	44101	ZB16C1	041/043	1.4541	7	N	7,7	30 min	Argon	02.02.06
14	80	RL	44201	ZB16C1	042	1.4541	7	N	7,7	30 min	Argon	02.02.06
14	50	RL	44203	ZB40C1	042	1.4541	7	N	7,7	30 min	Argon	02.02.06
14	50	RL	44205	ZB40C1	042	1.4541	7	N	7,7	30 min	Argon	02.02.06
14	50	RL	48001	ZB40C1	043/044	1.4541	7	N	7,7	30 min	Argon	02.02.06
14	50	RL	48004	ZB40C1	043/041	1.4541	7	N	7,7	30 min	Argon	02.02.06
15	50	RL	90002	ZB16C1	026	1.4541	16	N	17,6	30 min	RL	07.02.06
15	25	RL	43002	ZB16C1	018/026	1.4541	16	N	17,6	30 min	RL	07.02.06

rn.	DN	Fl.	Pi.nr.	Pipe class	P&I	Mat.	bar	Test Med.	Test	hold time	Bereich	Datum
16	80	OL	90001	ZB16C1	026	1.4541	16	N	17,6	30 min	OL	09.02.06
16	50	OL	21009	ZB16C1	012/026	1.4541	16	N	17,6	30 min	OL	09.02.06
16	50	OL	21024	ZB16C1	014/026	1.4541	16	N	17,6	30 min	OL	09.02.06
16	40	OL	40013	ZB10C1	016	1.4541	16	N	17,6	30 min	OL	09.02.06
16	40	OL	40102	ZB16C1	016/026	1.4541	16	N	17,6	30 min	OL	09.02.06
16	50	OL	61103	ZB16C1	011/026	1.4541	16	N	17,6	30 min	OL	09.02.06
16	25	OL	61104	ZB16C1	012	1.4541	16	N	17,6	30 min	OL	09.02.06
16	15	OL	61107	ZB16C1	012	1.4541	16	N	17,6	30 min	OL	09.02.06
16	25	OL	61108	ZB16C1	014/026	1.4541	16	N	17,6	30 min	OL	09.02.06
16	40	OL	61110	ZB16C1	012	1.4541	16	N	17,6	30 min	OL	09.02.06
16	25	OL	61204	ZB16C1	012	1.4541	16	N	17,6	30 min	OL	09.02.06
16	15	OL	61207	ZB16C1	012	1.4541	16	N	17,6	30 min	OL	09.02.06
17	50	NL	90004	ZB16C1	026	1.4541	16	N	17,6	30 min	NL	07.02.06
17	25	NL	21015	ZB16C1	015/026	1.4541	16	N	17,6	30 min	NL	07.02.06
17	50	N	23011	ZB16C1	011/026	1.4541	16	N	17,6	30 min	NL	07.02.06
17	25	NL	71103	ZB16C1	015	1.4541	16	N	17,6	30 min	NL	07.02.06
17	15	NL	71104	ZB16C1	015	1.4541	16	N	17,6	30 min	NL	07.02.06
17	15	NL	71203	ZB10C1	015	1.4541	16	N	17,6	30 min	NL	07.02.06
17	25	NL	71203	ZB16C1	015	1.4541	16	N	17,6	30 min	NL	07.02.06
17	25	NL	73017	ZB16C1	014/016	1.4541	16	N	17,6	30 min	NL	07.02.06
18	15	N	20028	AA40C1	010/015	1.0254	30	N	33	30 min	Seal N	01.02.06
19	25	RL	44104	ZB40C1	042	1.4541	40	N	44	30 min	Ar 1	08.02.06
20	25	RL	44204	ZB40C1	042	1.4541	40	N	44	30 min	Ar 2	08.02.06
21	25	R	48009	ZB40C1	044	1.4541	40	N	44	30 min	Ar HP	08.02.06
22	25	O	81020	ZB40C1	010/025	1.4541	12	N	13,2	30 min	Seal O	02.02.06
23	15	O	81021	ZB40C1	025/012	1.4541	12	N	13,2	30 min	Seal O	02.02.06
23	15	O	81022	ZB40C1	025/016	1.4541	12	N	13,2	30 min	Seal O	02.02.06
23	15	O	81028	ZB40C1	012	1.4541	12	N	13,2	30 min	Seal O	02.02.06

sheet 7