

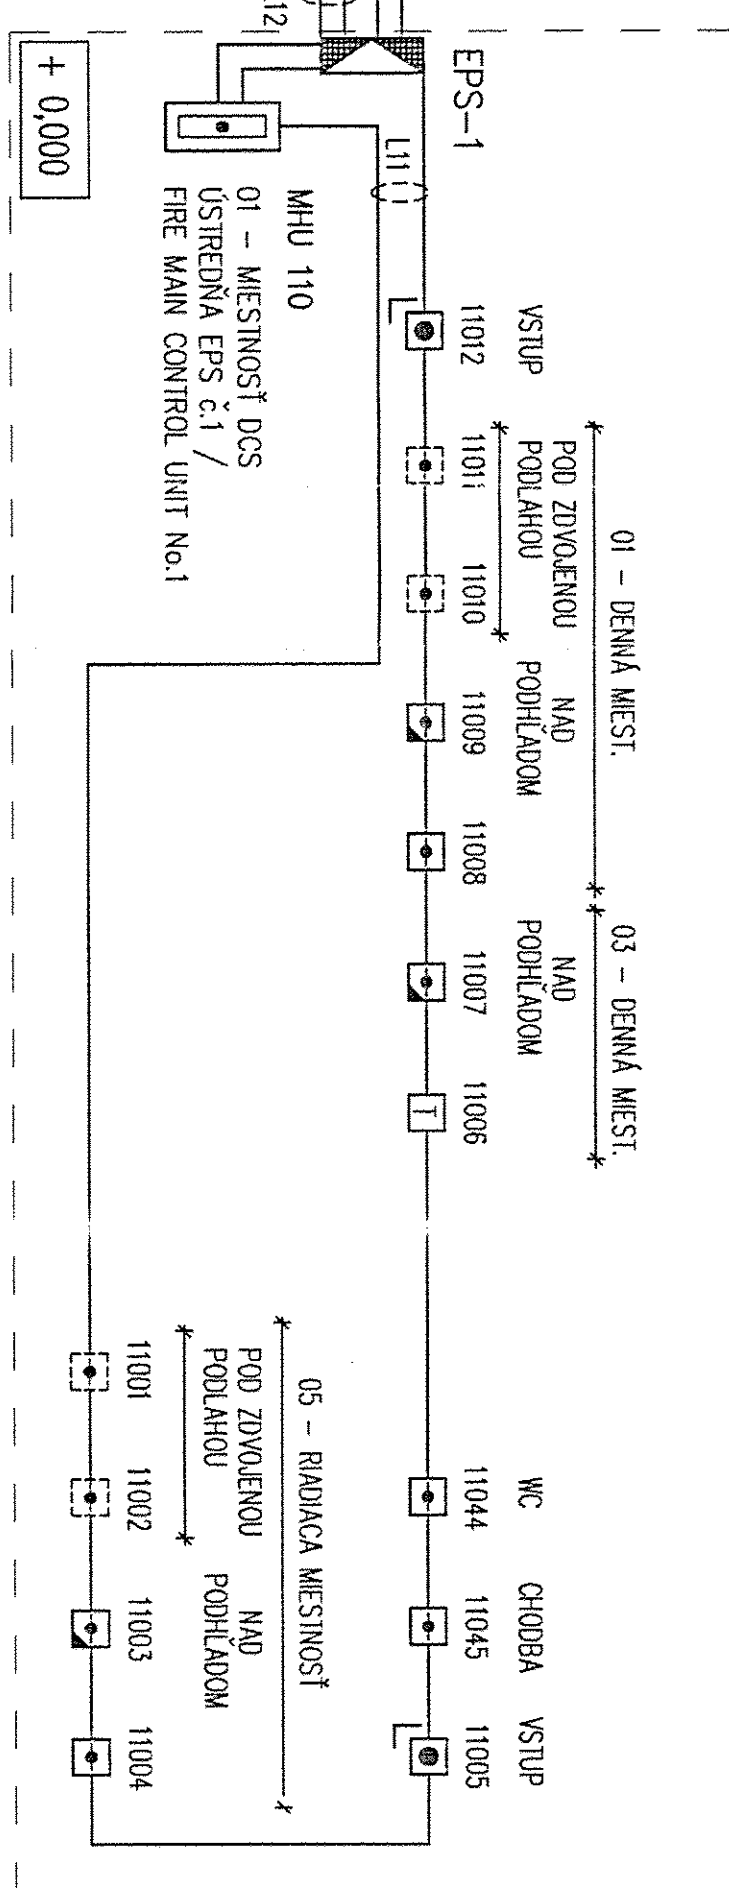
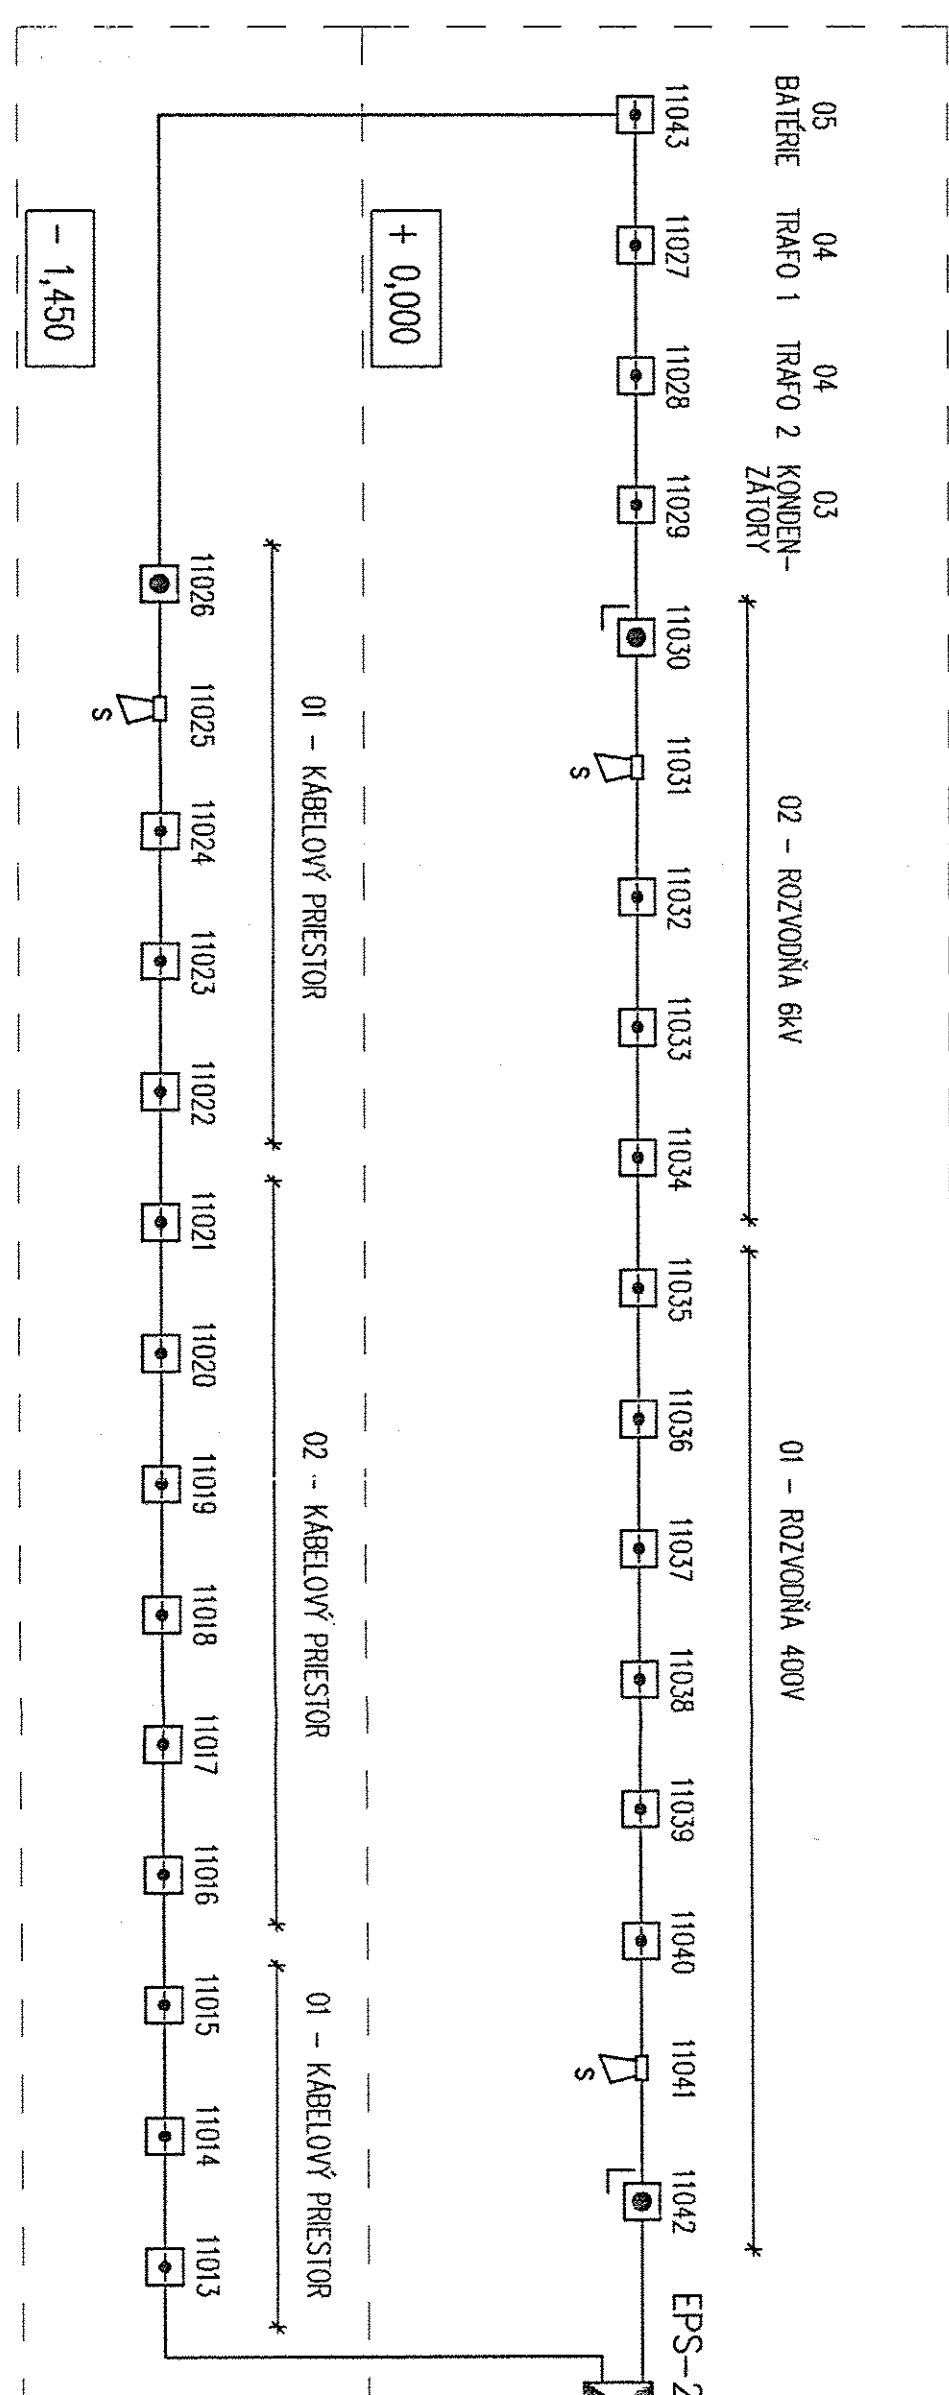
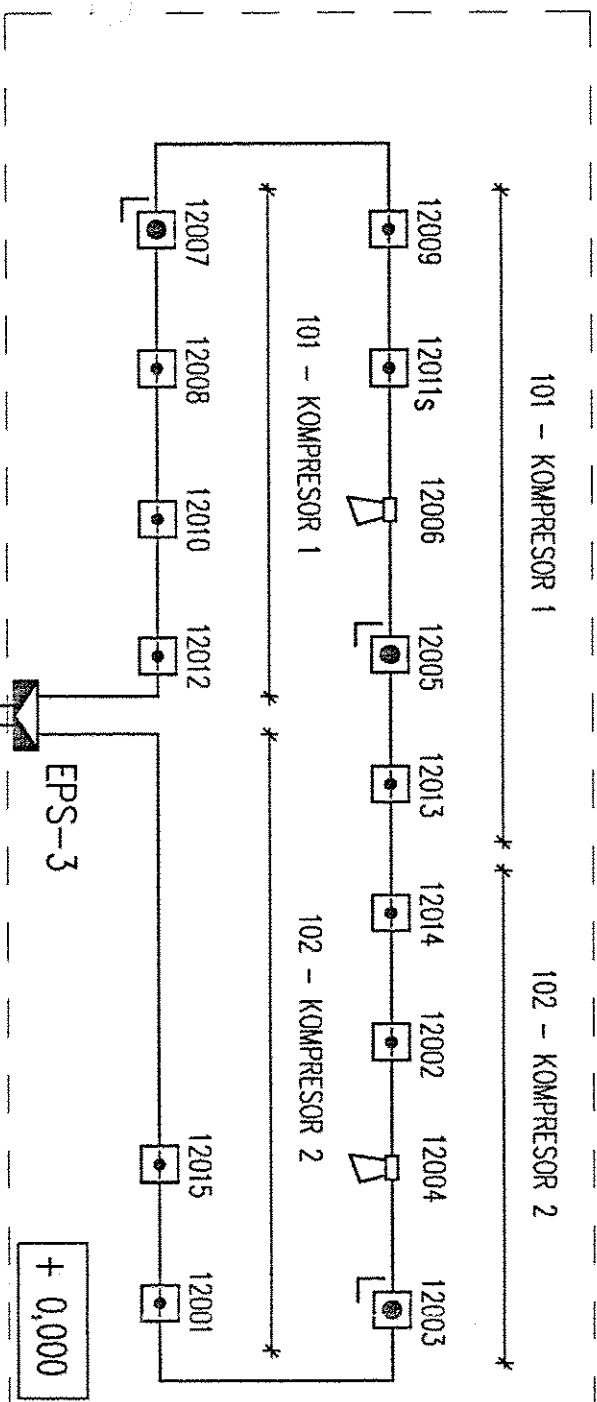



ROZVODNÁ T81 / ELECTRICAL ROOM T81

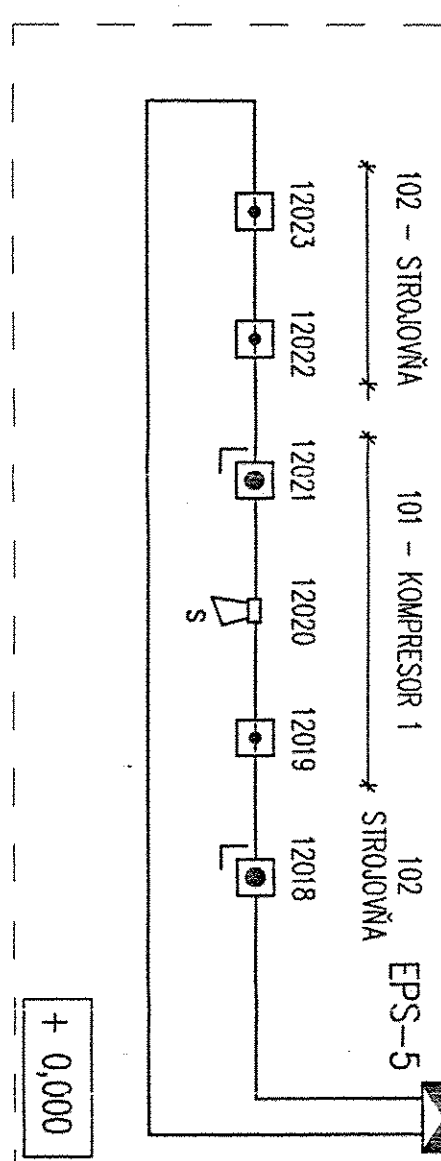

NIŽKOTEPLOTNÝ BLOK / AIR SEPARATION

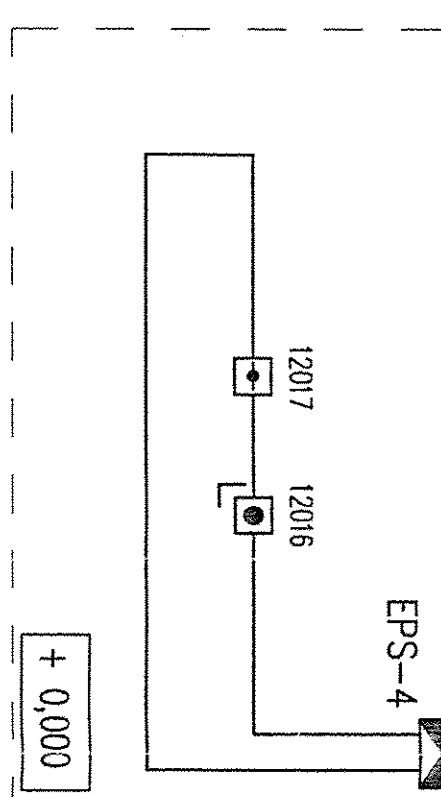



MIESTNOSŤ KONTROLY /
CONTROL BOX

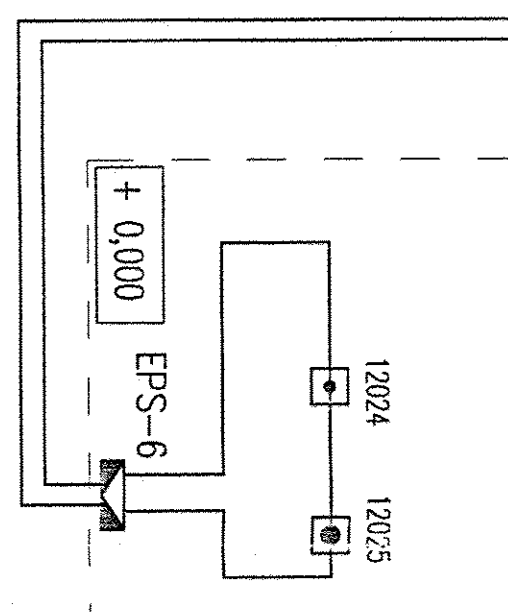

: 2 DC 24V, SELV

OGRAANA PRED UPAZOM ELEKTRICKYM PRUDOM PRI PORUCHE /
THE PROTECTION AGAINST ELECTRIC CURRENT INJURY IN CASE OF A TROUBLE
: SAMOČINNÝM ODPOJENÍM NAPÁJANIA / SELF-ACTING DISCONNECTION OF POWER SUPPLY
: MALÝM NAPÁTIÍM / SELV

PROSTREDIE / ENV
311 - ZAKLADNÉ/
411 - VONKAŠIE

 Ing. Jaroslav ANEŠ, spol. s r.o. Husova 63, 400 03 Kladno									
<div style="border: 1px solid black; padding: 5px; display: inline-block;">  AIR LIQUIDE </div>									
REPLACES: REPLACED BY:		TITLE: SCHEMA EPS 2 / DIAGRAM 2		ELEKTROPOŽÁRNÁ SIGNALIZACE/ELECTRICAL FIRE SYSTEM		AM5/3.EPS --14			
		JOB CODE: K 70101		SCALE		ORIGINAL FORM			
		REFERENCE: ASU No.9 KOŠICE		INC. DROTAŘOVA		INC. DROTAŘ			
				DATE JUN 2006		NAME <i>Jan Anes</i>			
				CHECKED		HISTORY FILE			
		SHEET: OF		SHEET:		REV:			
		DRAWING NO.:		4x44					